

Fig. 1

— 345 kV
 — 115 kV
 - - - 69 kV
 46 kV
 • GENERATOR
 □ SUBSTATION
 ■ SWITCHING STATION

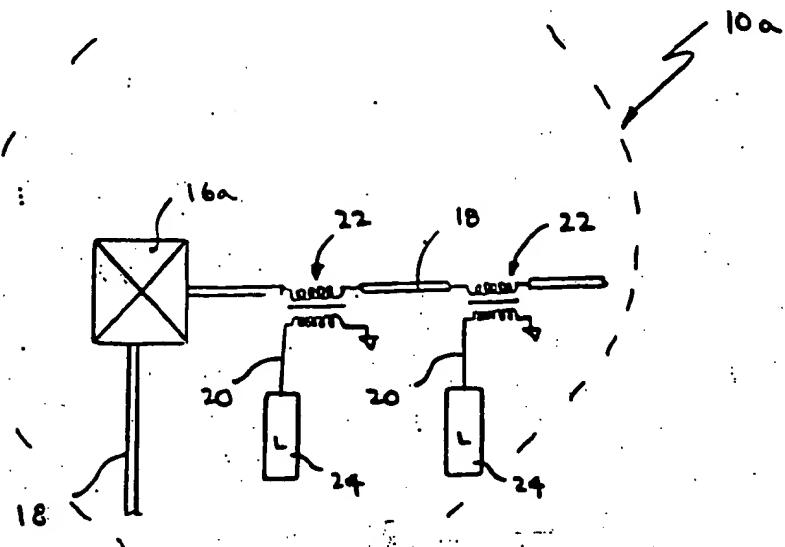
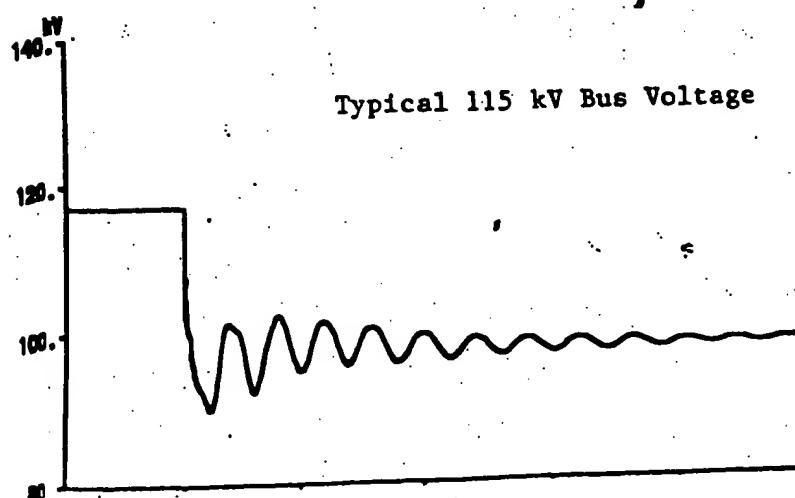


Fig. 2

DO NOT USE DO NOT USE DO NOT USE



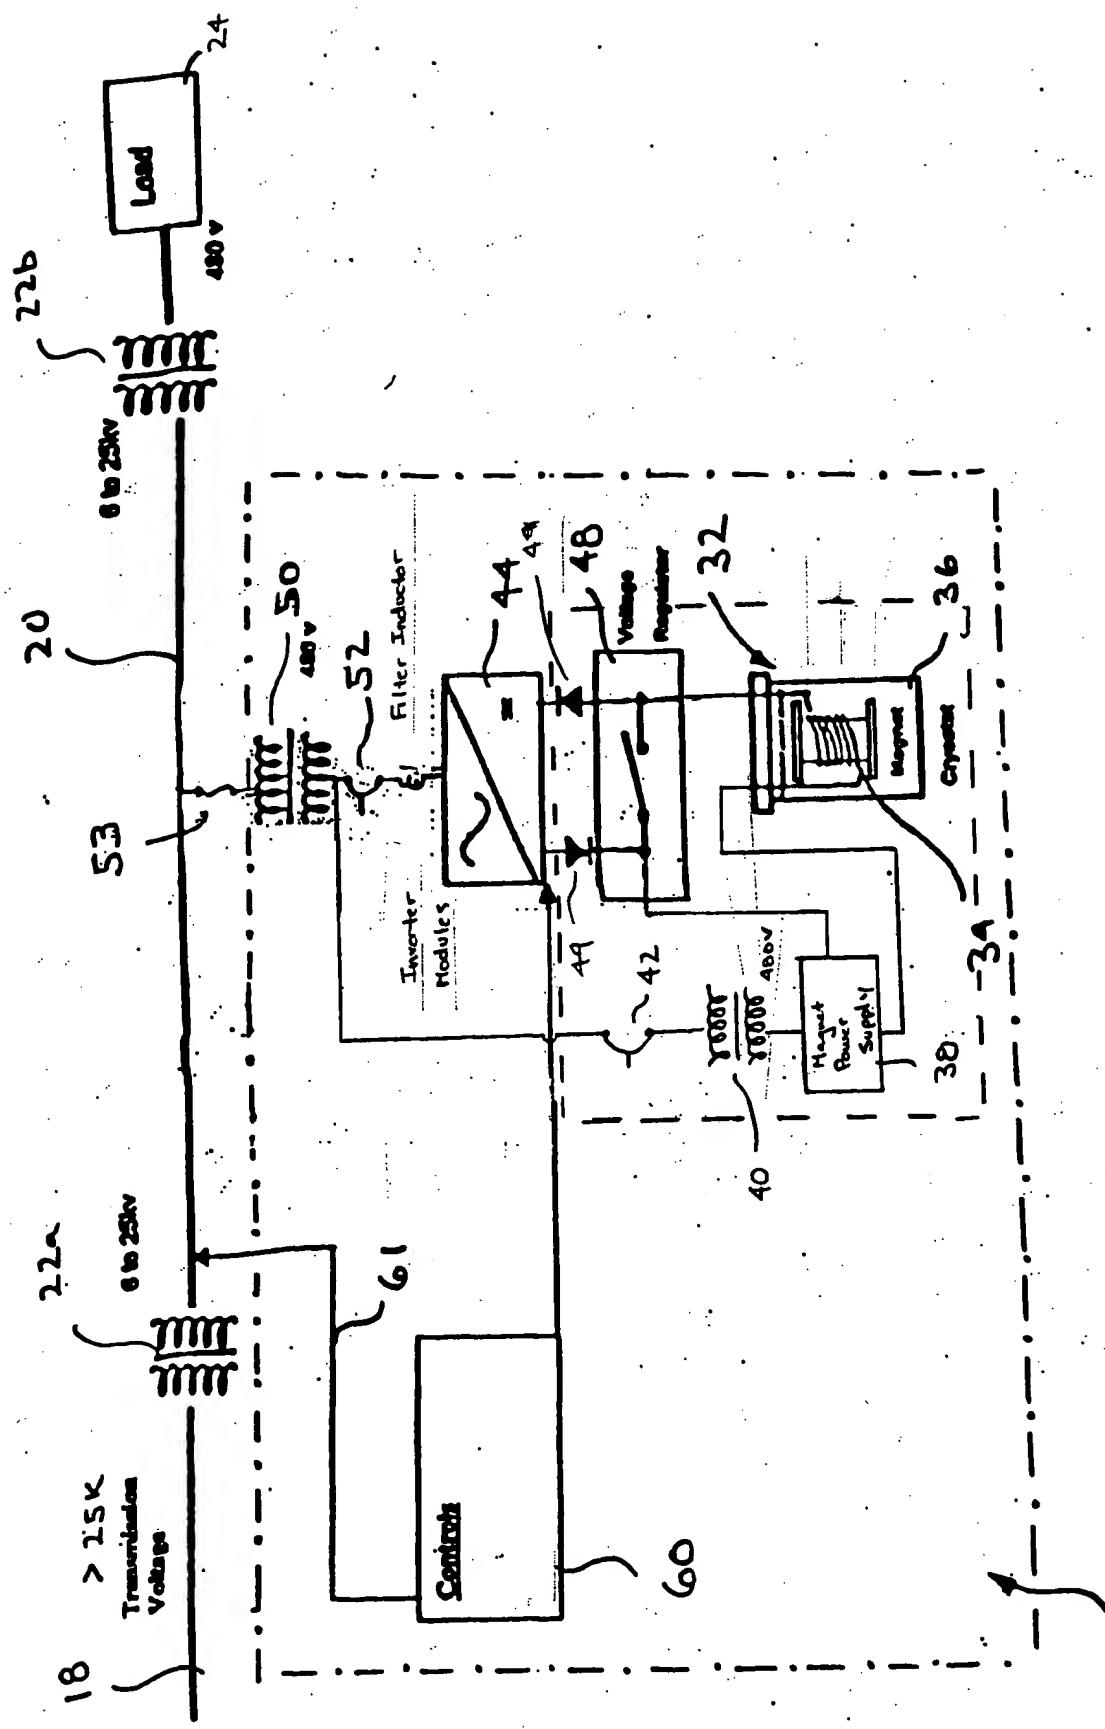
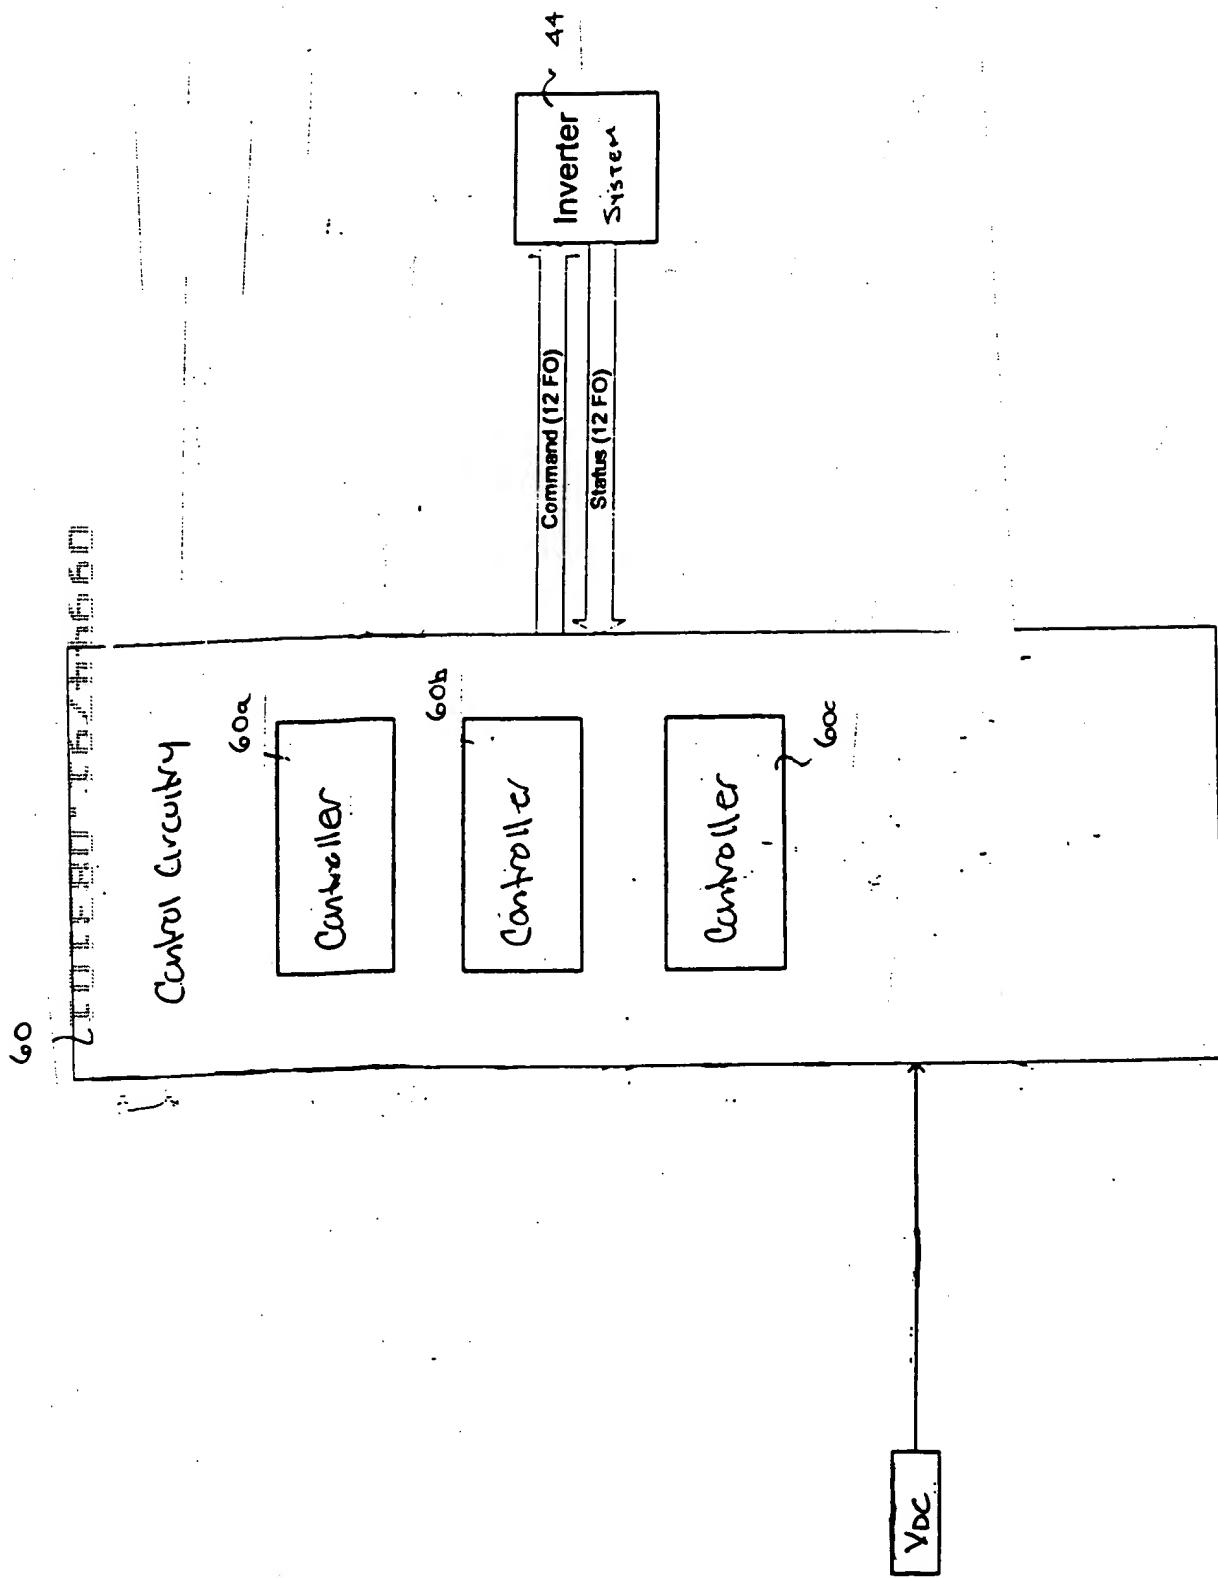


Fig. 4

FIG. 4A



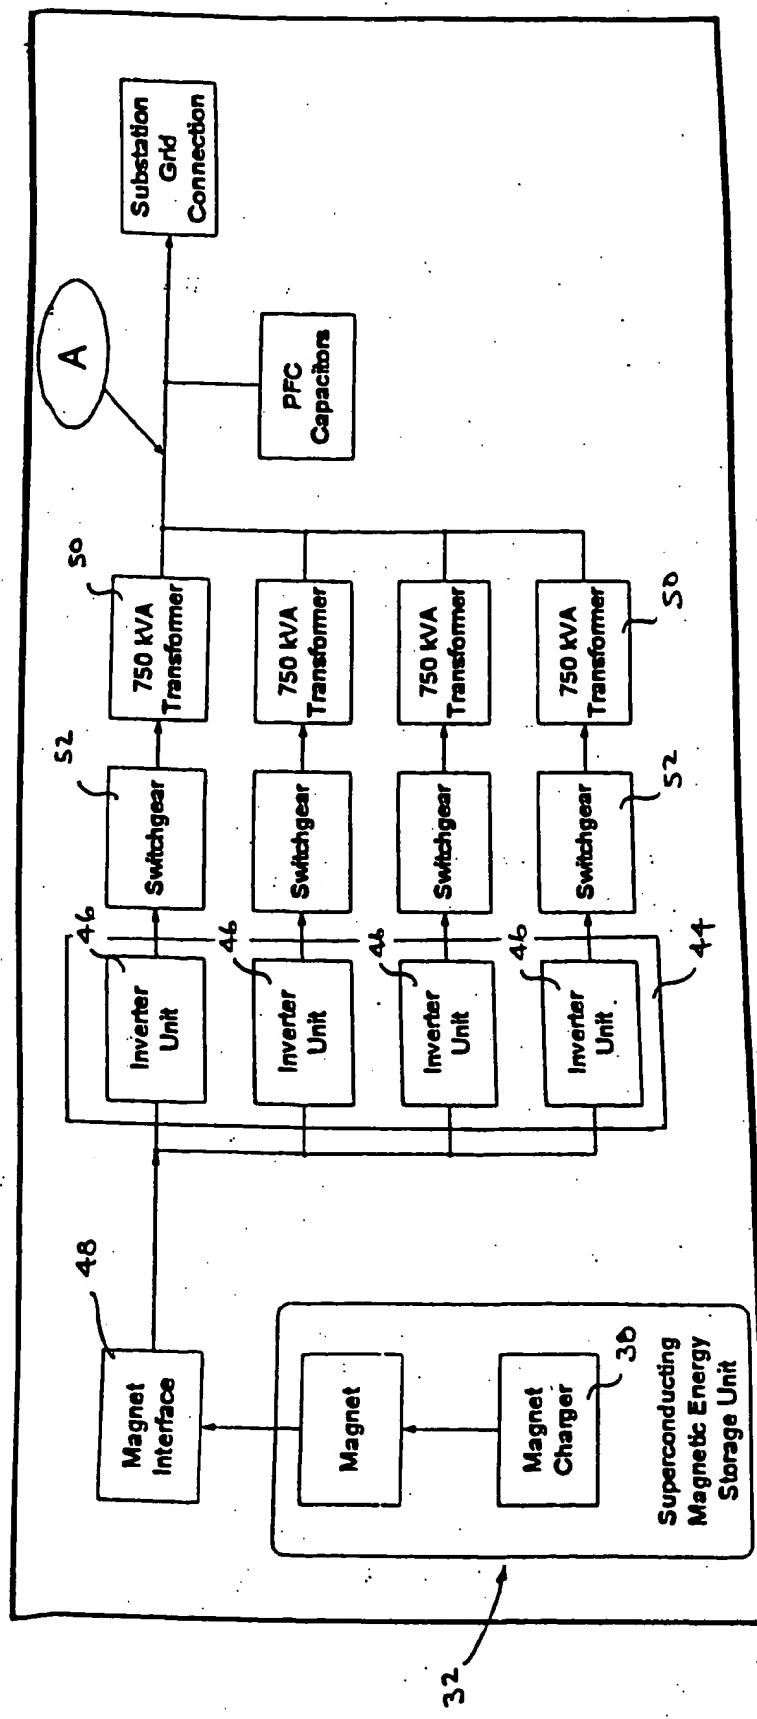


Fig. 5

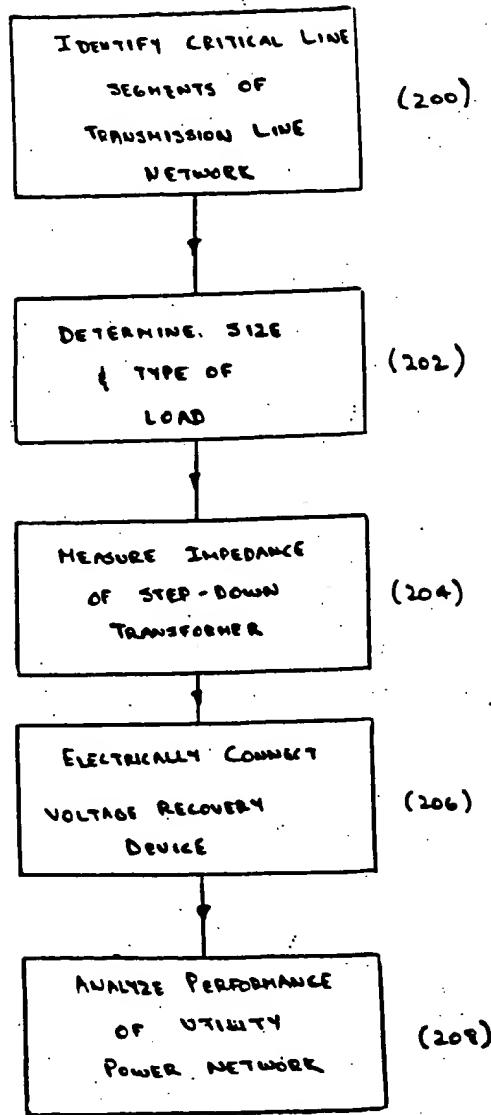


Fig. 6

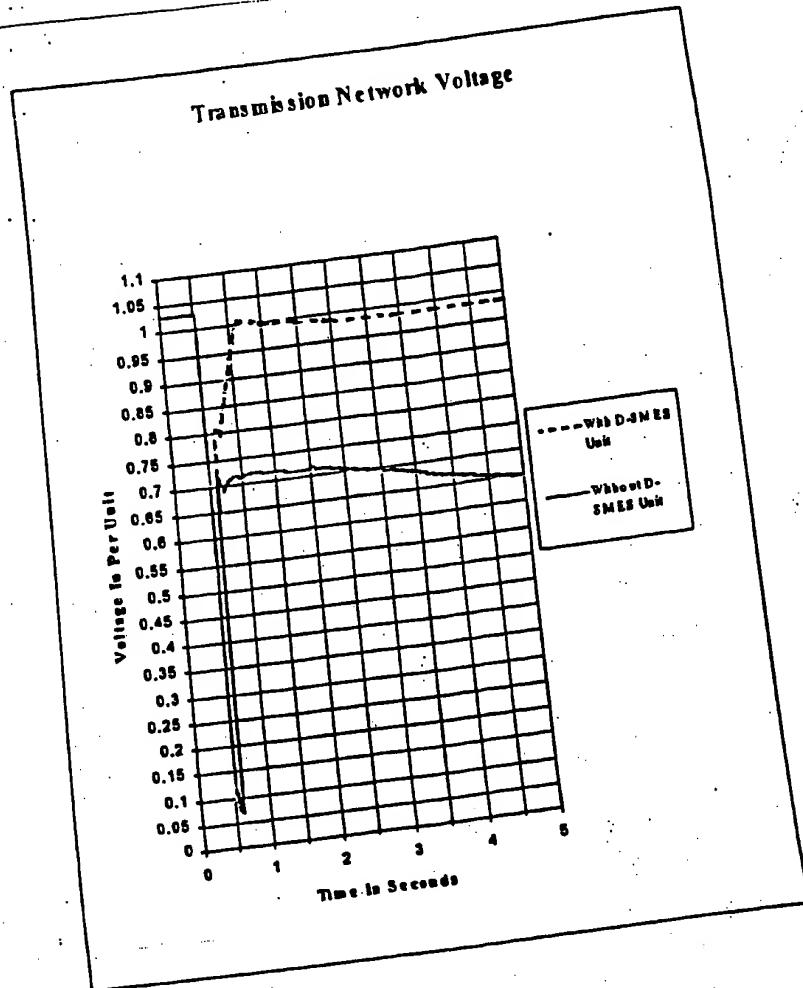


Fig. 7

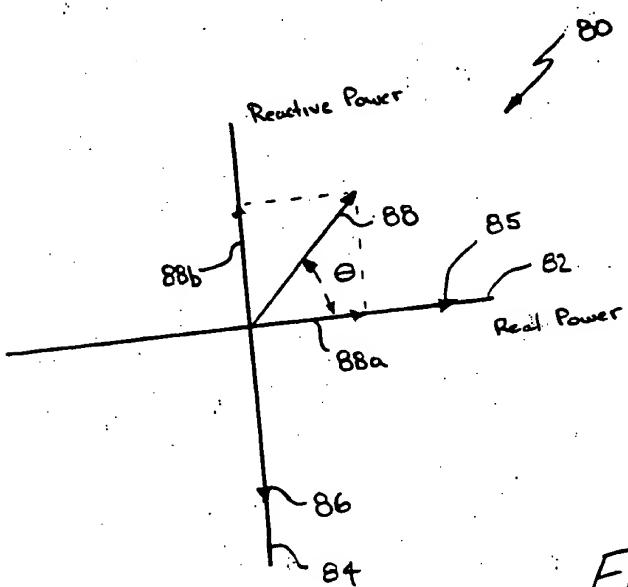


Fig. 8

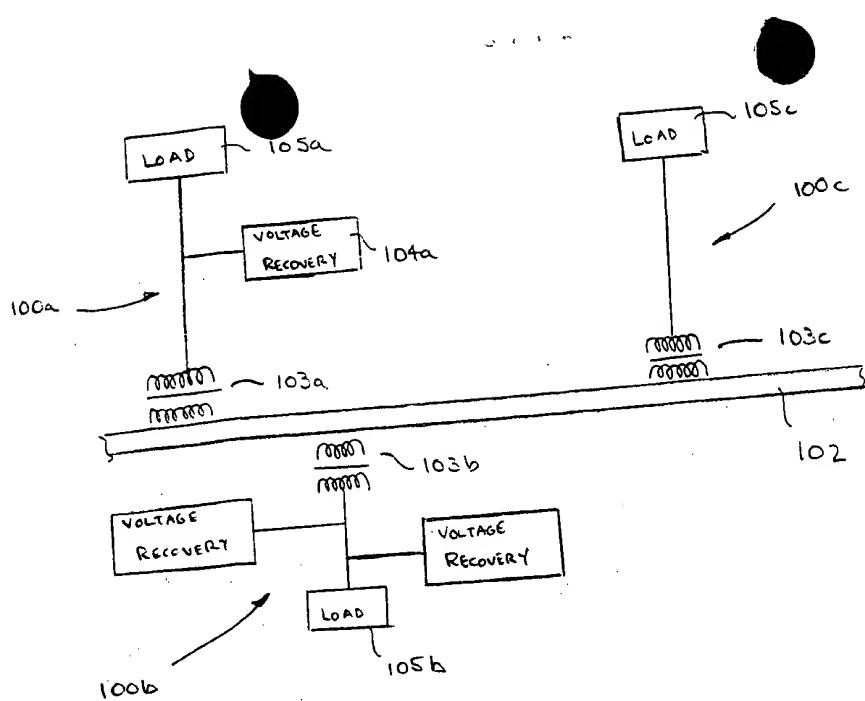


Fig. 9